



## ASPHALT MULTI-USE PATH

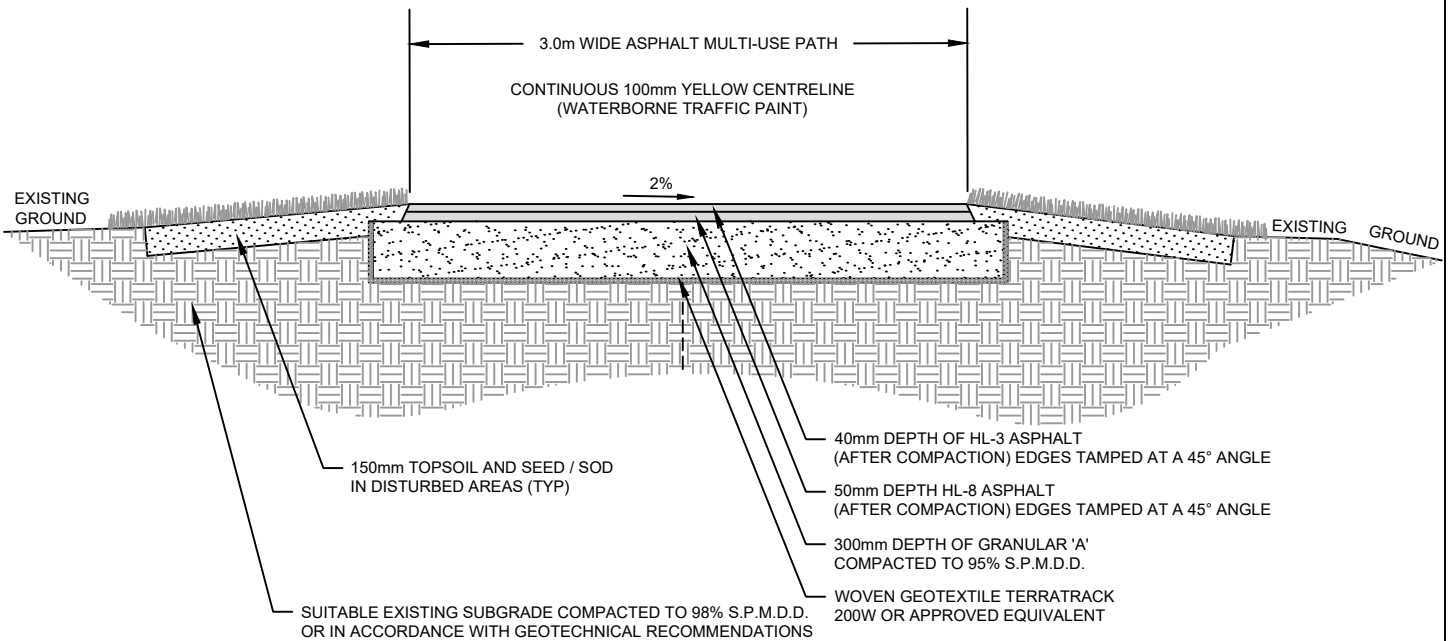

### NOTES

1. ASPHALT SURFACE TO BE IN ACCORDANCE WITH OPSS 310 SPECIFICATIONS.
2. GRANULAR BASE MATERIAL SHALL BE IN ACCORDANCE WITH OPSS 1010 SPECIFICATIONS.
3. MULTI-USE PATHWAY TO BE SUPERELEVATED TO ACHIEVE A 2.0% MINIMUM CROSSFALL.

## CONCRETE MULTI-USE PATH

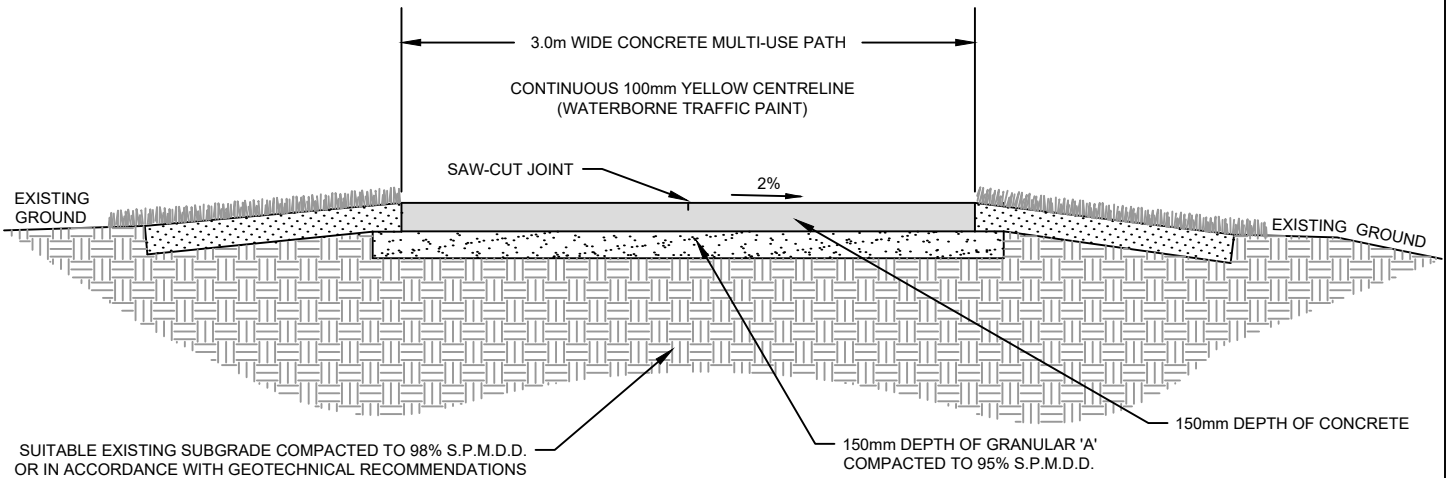

### NOTES

1. CONCRETE SHALL CONFORM TO OPSS MUNI 353 AND 1350 SPECIFICATIONS (32MPa, 5.0% - 8.0% AIR)
2. CONTRACTION JOINTS TO BE SAW-CUT TO 25% OF FULL DEPTH OF WALKWAY
3. EXPANSION JOINTS TO BE PLACED FULL DEPTH OF WALKWAY EVERY 15m AND WHERE WALKWAY ABUTS ANY RIGID STRUCTURE
4. GRANULAR BASE MATERIAL SHALL BE IN ACCORDANCE WITH OPSS 1010 SPECIFICATIONS.
5. MULTI-USE PATHWAY TO BE SUPERELEVATED TO ACHIEVE A 2.0% MINIMUM CROSSFALL.

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED